

1. FILTER FABRIC SHALL BE ADS 4000, GEOTEX 351 OR AND APPROVED NON-WOVEN GEOTEXTILE.
2. CRUSHED STONE SHALL BE MIN. 3/4" DIA.
3. UNDER DRAIN SHALL BE CONNECTED TO STORM DRAIN INLETS.
4. CONNECTIONS TO INLETS SHALL BE CORED TO THE DIAMETER OF THE DRAIN PIPE PLUS 1/2" MAX.
5. GROUT SHALL BE NONSHRINK AND NONMETALLIC
6. DRAIN PIPE SHALL BE CUT FLUSH WITH INSIDE OF INLET.

1
1

Revision Date:


Scale : N/A	Date : 06/01/05
Design :	
Drawn : GAV	
Dwg. File : PIP_001.DWG	
Project No. : STANDARD-DETAILS	



DRAINAGE DETAILS ROADWAY UNDERDRAIN


PAGE

1

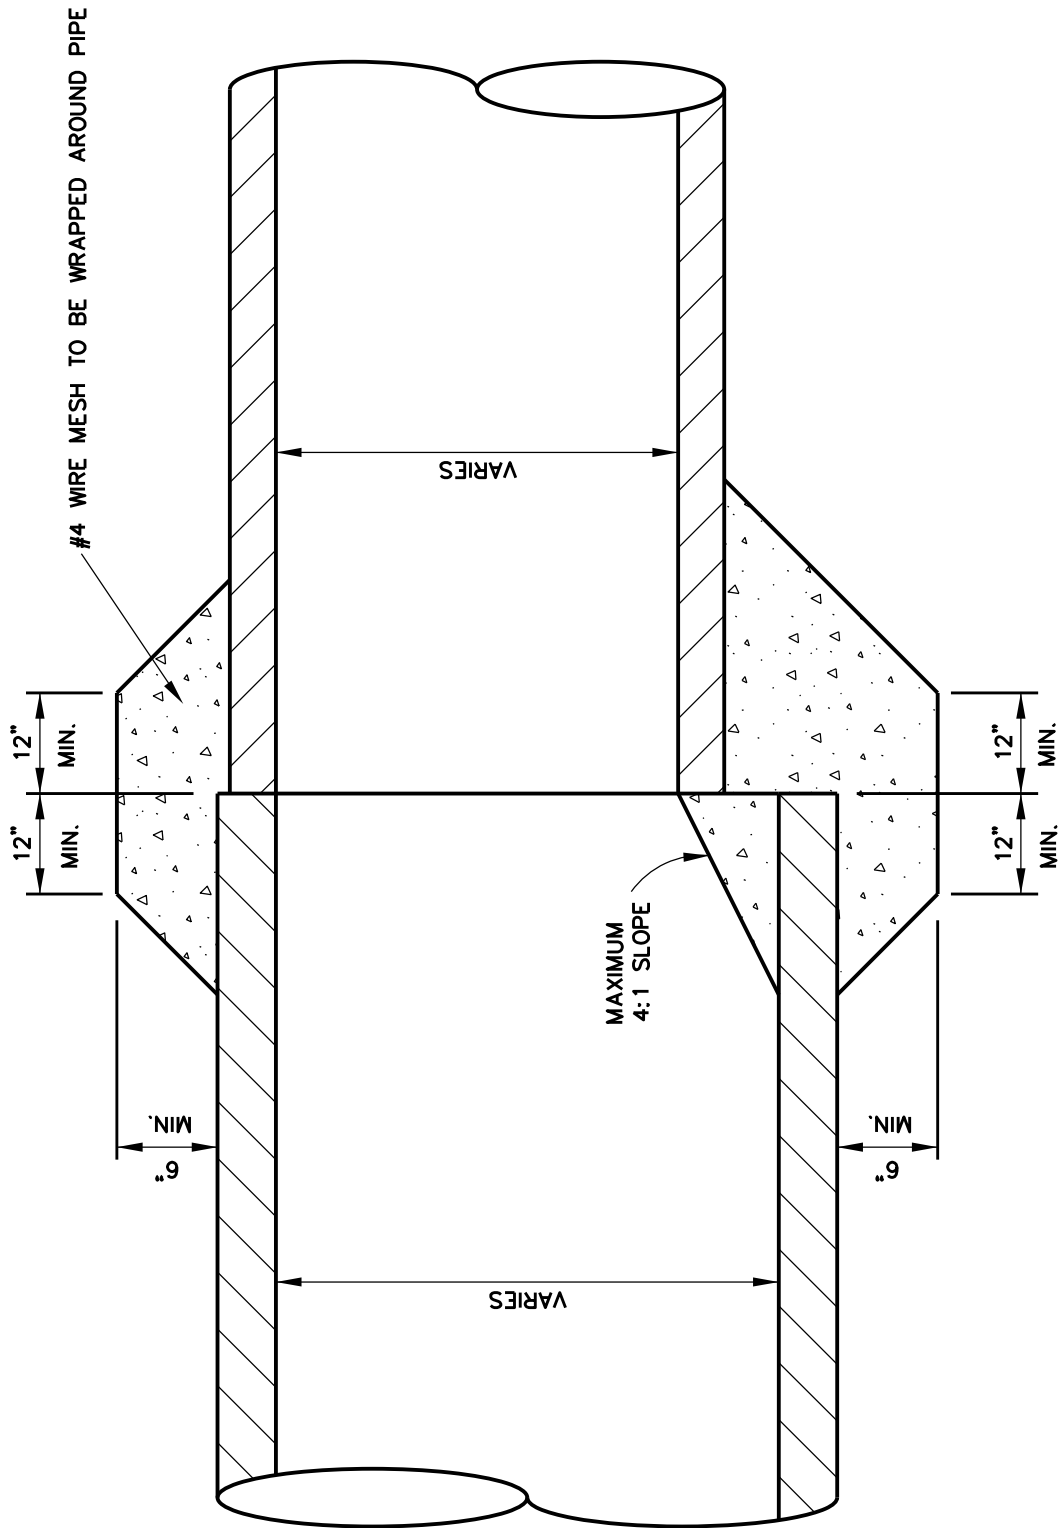

DETAIL OF CONCRETE COLLAR

FOR END TO END EXTENSIONS



Revision Date: _____

Scale : N/A Date : 06/01/05
 Design :
 Drawn : GAV
 Dwg. File : PIP_002.DWG
 Project No. : STANDARD-DETAILS



**STORM SEWER DETAILS
 CONCRETE COLLAR
 INSTALLATION**